


REPLACEMENT WINDOWS/DOORS

7550 Sunwood Drive NW
Ramsey, Minnesota 55303
City Hall: 763-427-1410
Building and Inspections: 763-433-9850
Fax: 763-433-9848
www.cityoframsey.com/permits

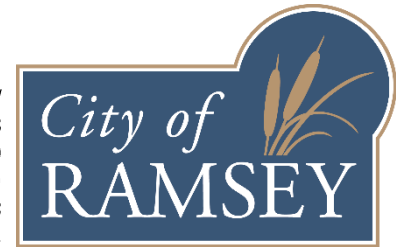

This pamphlet is a compilation of some of the standard requirements based on the State Building Code and City Zoning Code for projects of this type. This information packet does not contain all of the specific codes for construction and should only be used as a guide. The permittee is responsible to meet all code requirements applicable to each project.

Q: Are there any special requirements I should be aware of?

A: Yes, safety or tempered glazing is required in all hazardous locations. The following installations are defined as "hazardous locations":

1. All glass within 24 inches of either side of a door and less than 60 inches from the floor.
2. All glazing in railings regardless of area or height above a walking surface. Included are structural baluster panels and nonstructural infill panels.
3. Glazing in walls and fences enclosing indoor and outdoor swimming pools, hot tubs, and spas where the bottom edge of the glazing is less than 60 inches above a walking surface and within 60 inches horizontally of the water's edge.
4. Glazing adjacent to stairways, landings and ramps within 36 inches horizontally of a walking surface when exposed glass is less than 60 inches above the walking surface.
5. All glazing within doors.
6. Glass less than 18 inches of a walking surface and greater than 9 sq. feet for any single pane.
7. Glazing adjacent to stairways within 60 inches horizontally of the bottom stair tread when the exposed glass is less than 60 inches vertically from the nosing of the bottom tread.

Additional notes regarding window and door placement.

1. Any garage door leading from the home directly to a garage must be a minimum 1-3/8 inch solid wood door, 1-3/8 inch solid or honeycomb steel door or a 20-minute fire rated door.
2. All exterior windows and doors must have corrosion resistant flashing installed over the top of the unit.
3. When applying for the permit you will be required to specify the quantity and locations for all windows and doors to be replaced.
4. Manufacture installation requirements shall be available on site for inspection.
5. Replacement windows are the manufacturer's largest standard size that will fit in the existing frame or rough opening and the window must be the same operating style. R310.1.5

Calculating Open Area for Window in Square Feet

Height	Width																
	20"	21"	22"	23"	24"	25"	26"	27"	28"	29"	30"	31"	32"	33"	34"	35"	36"
24"	3.3	3.5	3.7	3.8	4.0	4.2	4.3	4.5	4.7	4.8	5.0	5.2	5.3	5.5	5.7	5.8	6.0
26"	3.6	3.8	4.0	4.2	4.3	4.5	4.7	4.9	5.1	5.2	5.4	5.6	5.8	6.0	6.1	6.3	6.5
28"	3.9	4.1	4.3	4.5	4.7	4.9	5.1	5.3	5.4	5.6	5.8	6.0	6.2	6.4	6.6	6.8	7.0
30"	4.2	4.4	4.6	4.8	5.0	5.2	5.4	5.6	5.8	6.0	6.3	6.5	6.7	6.9	7.1	7.3	7.5
32"	4.4	4.7	4.9	5.1	5.3	5.6	5.8	6.0	6.2	6.4	6.7	6.9	7.1	7.3	7.6	7.8	8.0
34"	4.7	5.0	5.2	5.4	5.7	5.9	6.1	6.4	6.6	6.8	7.1	7.3	7.6	7.8	8.0	8.3	8.5
36"	5.0	5.3	5.5	5.8	6.0	6.3	6.5	6.8	7.0	7.3	7.5	7.8	8.0	8.3	8.5	8.8	9.0
38"	5.3	5.5	5.8	6.1	6.3	6.6	6.9	7.1	7.4	7.7	7.9	8.2	8.4	8.7	9.0	9.2	9.5
40"	5.6	5.8	6.1	6.4	6.7	6.9	7.2	7.5	7.8	8.1	8.3	8.6	8.9	9.2	9.4	9.7	10.0
42"	5.8	6.1	6.4	6.7	7.0	7.3	7.6	7.9	8.2	8.5	8.8	9.0	9.3	9.6	9.9	10.2	10.5
44"	6.1	6.4	6.7	7.0	7.3	7.6	7.9	8.3	8.6	8.9	9.2	9.5	9.8	10.1	10.4	10.7	11.0
46"	6.4	6.7	7.0	7.3	7.7	8.0	8.3	8.6	8.9	9.3	9.6	10.0	10.2	10.5	10.9	11.2	11.5
48"	6.7	7.0	7.3	7.7	8.0	8.3	8.7	9.0	9.3	9.7	10.0	10.3	10.7	11.0	11.3	11.7	12.0
50"	6.9	7.3	7.6	8.0	8.3	8.7	9.0	9.4	9.8	10.1	10.4	10.8	11.1	11.5	11.8	12.2	12.5
52"	7.2	7.6	7.9	8.3	8.7	9.0	9.4	9.8	10.1	10.5	10.8	11.2	11.6	11.9	12.3	12.6	13.0
54"	7.5	7.9	8.3	8.6	9.0	9.4	9.8	10.1	10.5	10.9	11.3	11.6	12.0	12.4	12.8	13.1	13.5
56"	7.8	8.2	8.6	8.9	9.3	9.7	10.1	10.5	10.9	11.3	11.7	12.1	12.4	12.8	13.2	13.6	14.0
58"	8.0	8.5	8.9	9.3	9.7	10.1	10.5	10.9	11.3	11.7	12.1	12.5	12.9	13.3	13.7	14.1	14.5
60"	8.3	8.8	9.2	9.6	10.0	10.4	10.8	11.3	11.7	12.1	12.5	12.9	13.3	13.8	14.2	14.6	15.0